



3131 Indian Road • Boulder, CO 80301 USA (888) 928-8663 • Fax (303) 444-2903 sales@ccontrolsys.com

www.ccontrolsys.com


WNB-2.25.13: Specifications are subject to change

Energy coming from the grid is metered by the WattNode meter

The portion of renewable energy exported to the utility grid is measured by the WattNode meter




The total amount of renewable energy produced by the system is measured by the WattNode meter.

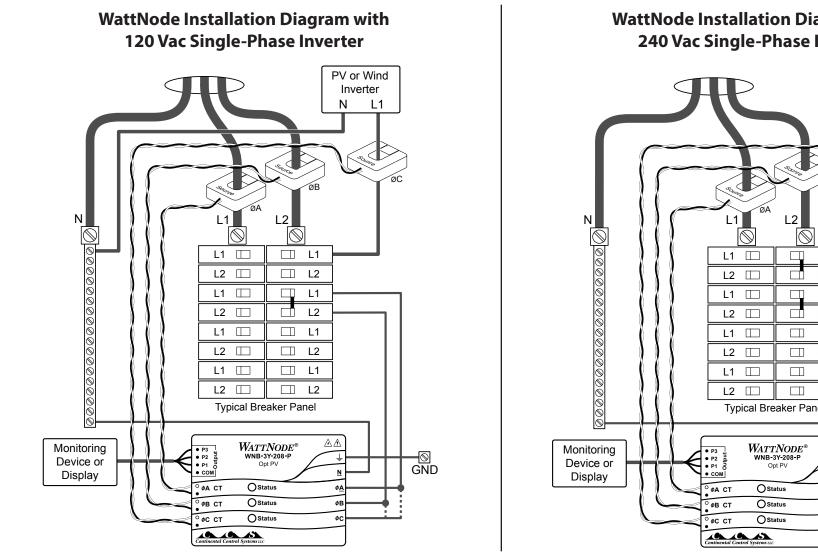

## Contractor or OEM pricing may apply: contact CCS

Quantity 1 of WNB-3Y-208P Opt PV	\$217.80
Quantity 2 of ACT-0750-150	\$43.50
Quantity 1 of ACT-0750-030	\$43.50
LCDA Display Options	consult factory

WattNode Installation Diagram with 240 Vac Single-Phase Inverter

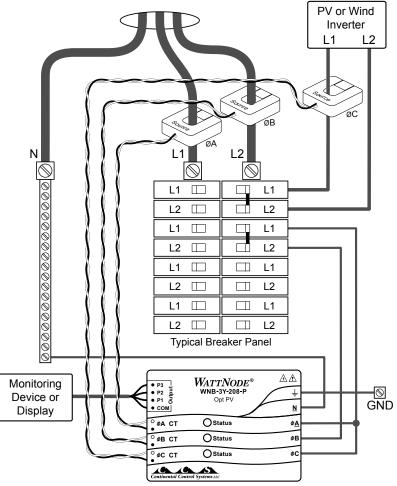



3131 Indian Road • Boulder, CO 80301 USA (888) 928-8663 • Fax (303) 444-2903 sales@ccontrolsys.com www.ccontrolsys.com